

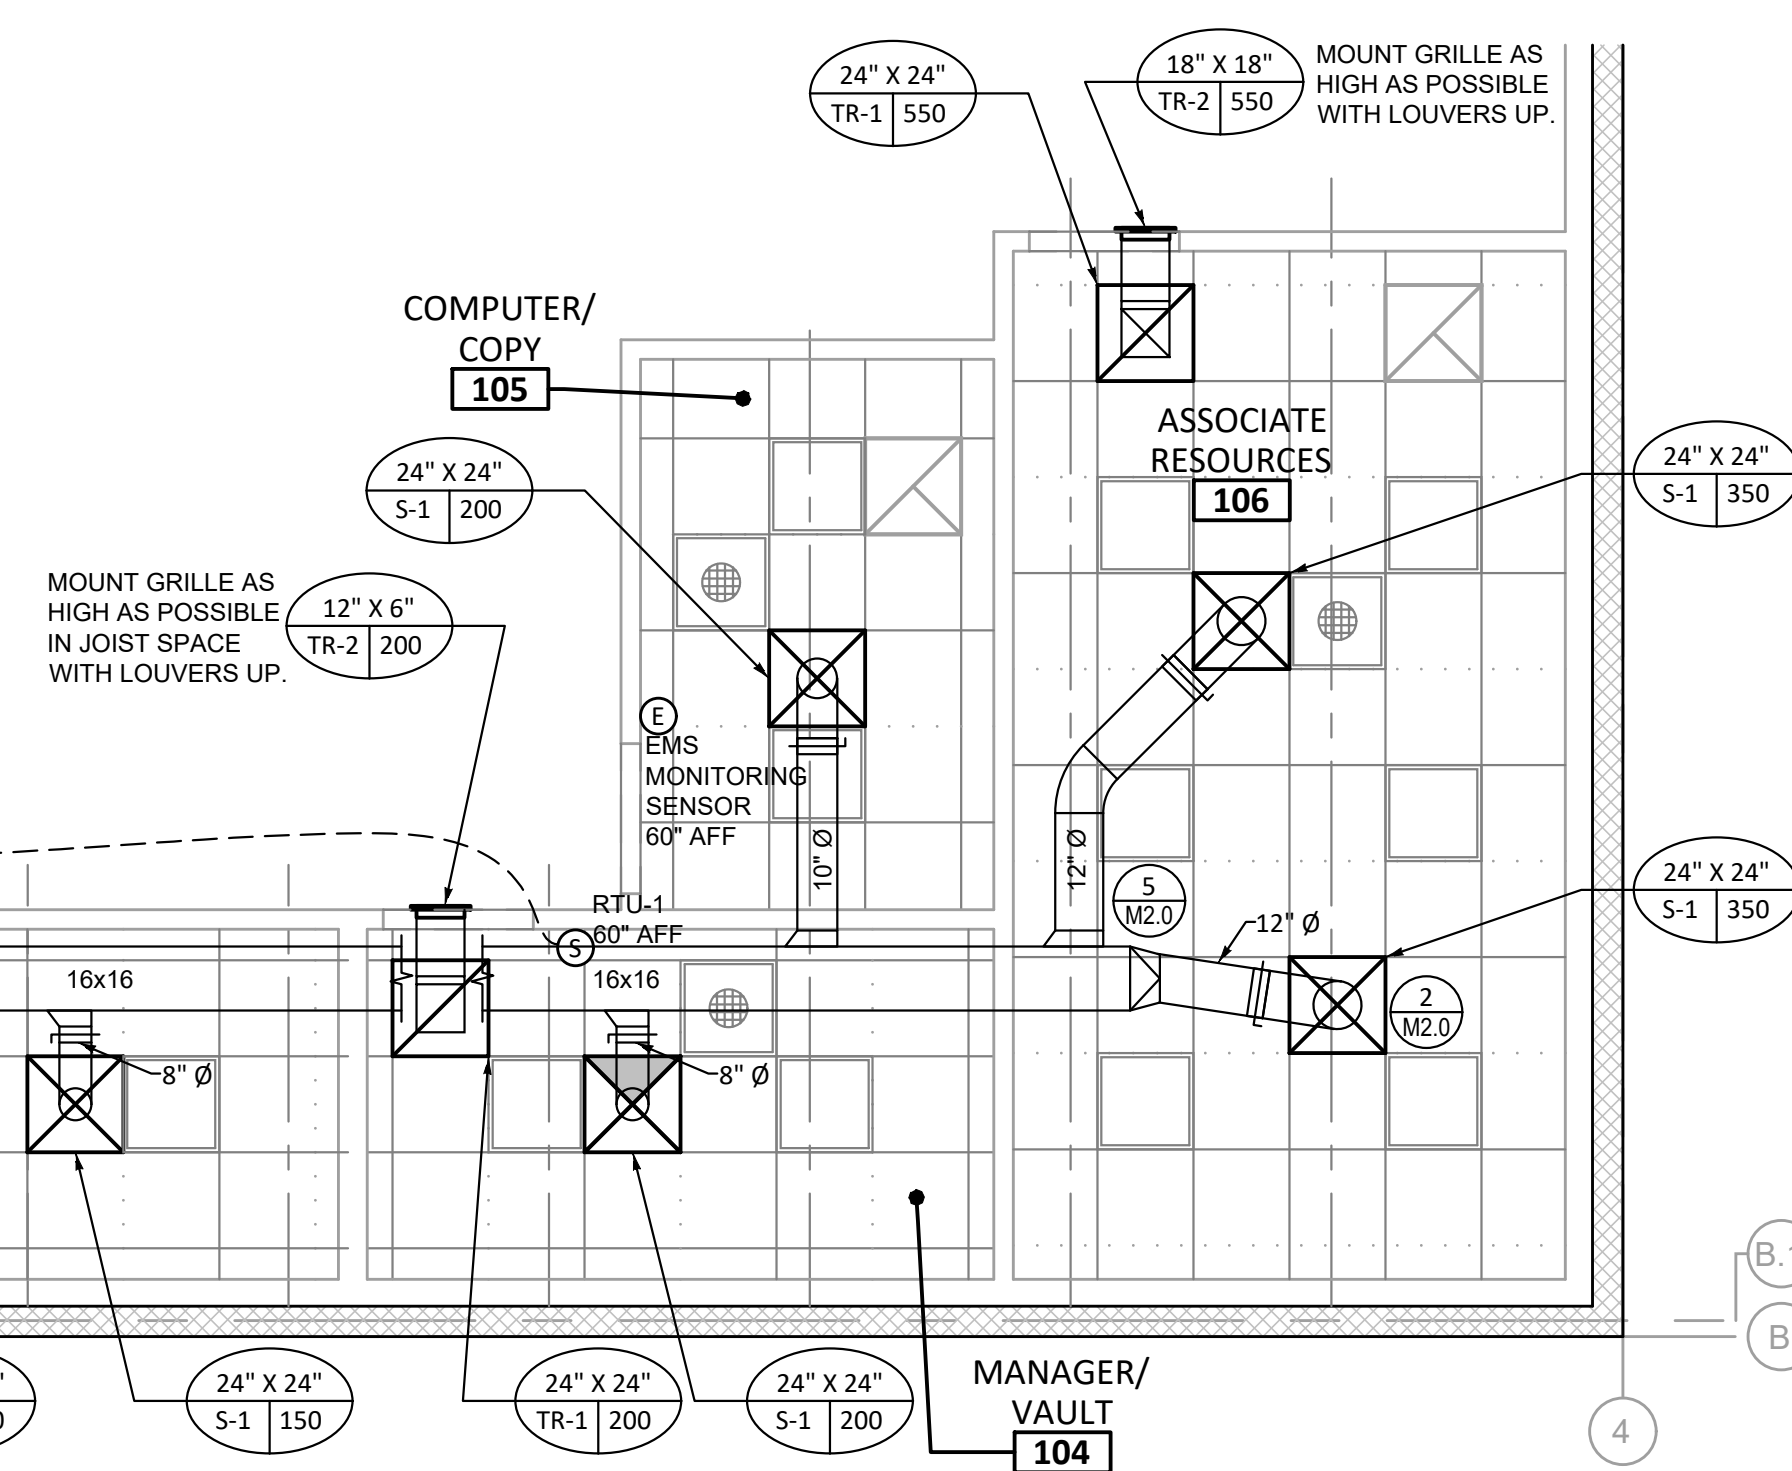


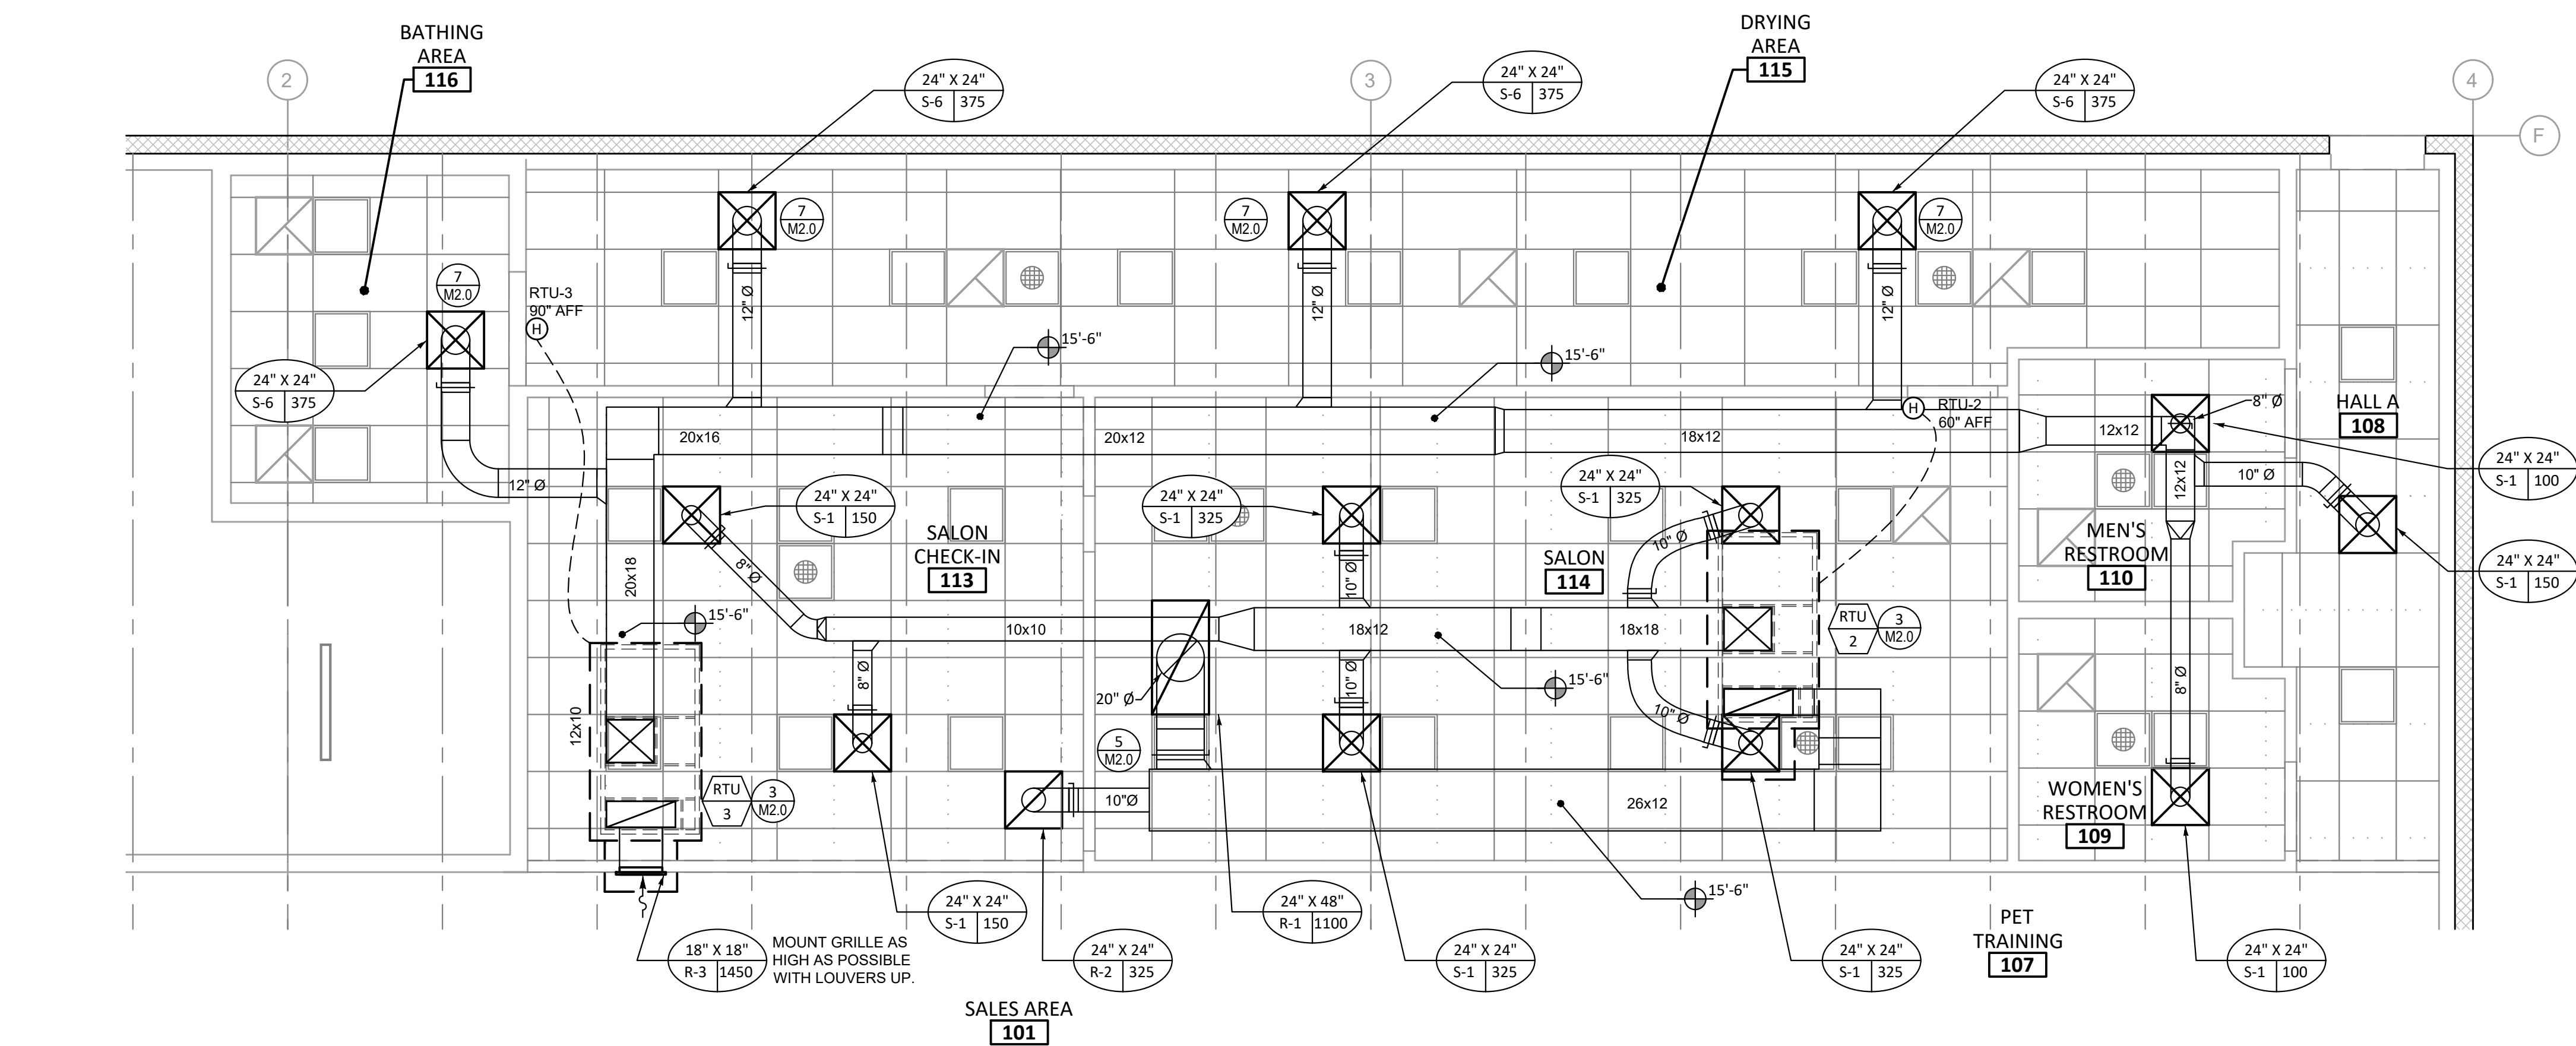

- ## NOTES TYPICAL FOR ALL DUCTWORK
- A. EXPOSED SUPPLY/RETURN DUCTWORK SHALL BE INTERNALLY LINED (NO DUCT WRAP INSULATION FOR EXPOSED DUCTWORK).
 - B. ALL CONCEALED SUPPLY AIR DUCTWORK (ABOVE T-BAR CEILINGS) IS TO BE THERMALLY INSULATED, INCLUDING FLEXIBLE SPIRAL DUCTING.
 - C. ALL VERTICAL SUPPLY AIR DUCTWORK DROPS FROM THE ROOF TOP UNITS SHALL HAVE A SMOOTH RADIUS BEND TRANSITION TO THE HORIZONTAL DISTRIBUTION.
 - D. ALL VOLUME DAMPERS FOR AIR DEVICES SHALL BE INSTALLED TO BE ACCESSIBLE FOR BALANCING. LOCATE WITHIN 24" OF CEILING.
 - E. VOLUME DAMPERS SHALL HAVE 1" STAND-OFFS FOR INSULATION THICKNESS.
 - F. ALL VOLUME DAMPERS MUST HAVE FLUORESCENT TAPE FLAGGING TO IDENTIFY LOCATIONS FOR BALANCER.

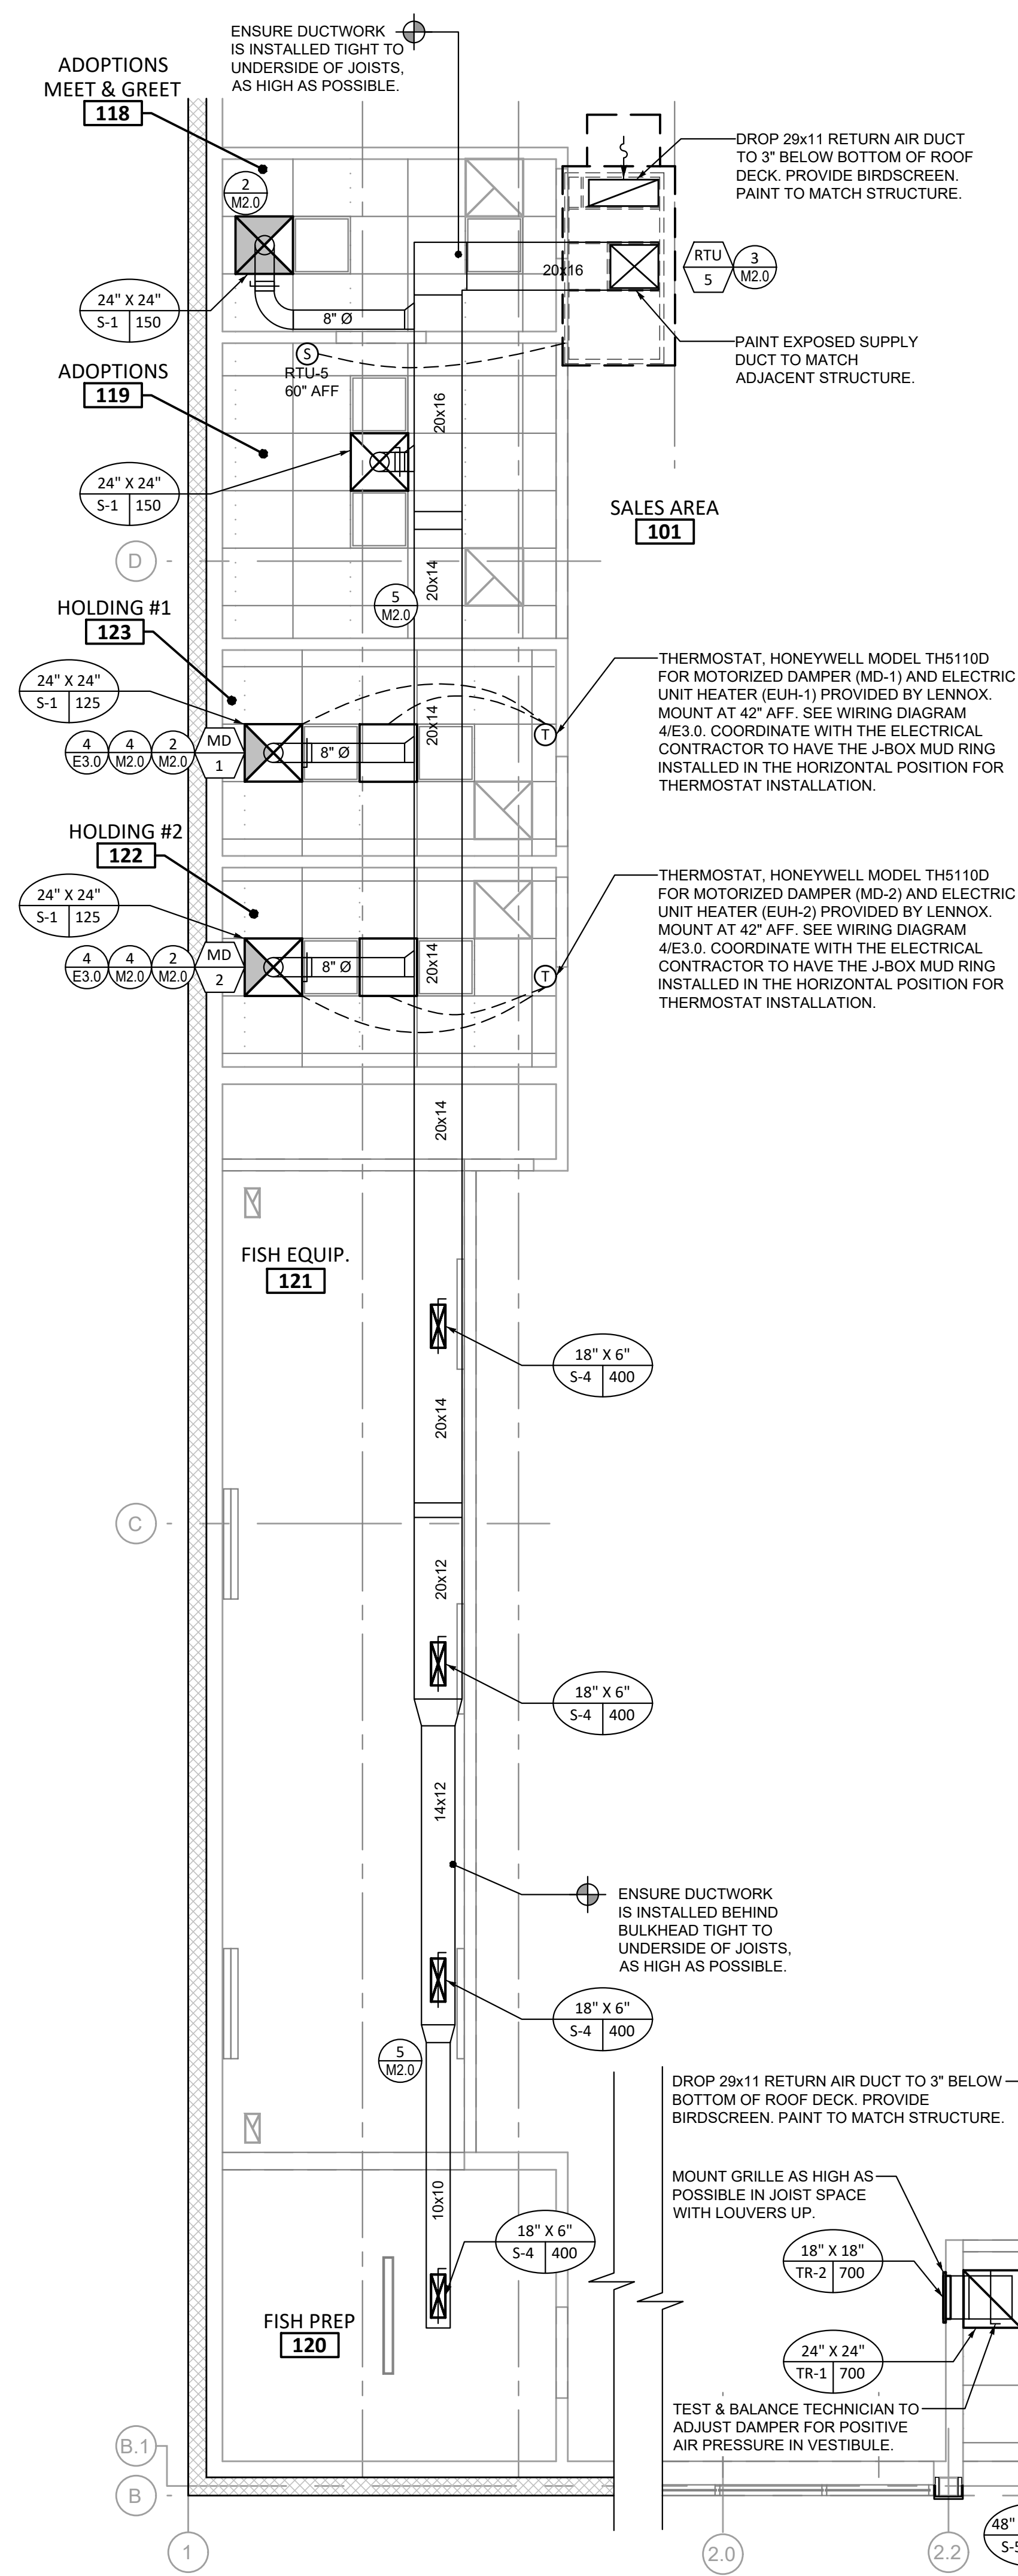