


LIGHT FIXTURE SCHEDULE:					
TYPE	MANUFAC.	CATALOG #	VOLT.	LAMP TYPE	WATTS
A4	CURRENT powered by GE	LUS440-52-V1-135VQCSWHITE (FIXTURE) AK-LUS-A-SK-04-01/10-WKTE (STARTER KIT)	MVOLT	LED	37
A8	CURRENT powered by GE	LUS0840-A0-V1-135VQCSWHITE (FIXTURE) AK-LUS-A-SK-08-01/10-WKTE (STARTER KIT)	MVOLT	LED	75
BA	CURRENT powered by GE	LVT-22-B-040-MM-835-VQ-LT-WHITE (FIXTURE)	MVOLT	LED	37
BG	NEORAY (DEFINE 2) by COOPER	S122DW-C1005D830-4F0-1-UDD-F-W	MVOLT	LED	43
EM	EMERGLITE	EF150-...D-LMC	24V	(1 or 2) 6W MR16 LED	6/12
G4	CURRENT powered by GE	LUS440-52-V1-135VQCSWHITE (FIXTURE) AK-LUS-A-SK-04-01/10-WKTE (STARTER KIT)	MVOLT	LED	37
L	CURRENT powered by GE	EW53-0-A7-D1-40-1-DK82	MVOLT	LED	25
M	CURRENT powered by GE	RC0615-835-WD-SD-CL-MR1V-10	120	LED	19
S	EMERGLITE	EA SERIES EAMU - RUNNING MAN	UNIVERSAL	LED	2.5
W	EMERGLITE	E5L SERIES 24ESL350/O OR 2	UNIVERSAL	SEE REMARKS	350


- CONTRACTOR SHALL CONTACT LIGHTING DISTRIBUTOR, GRAYBAR ELECTRIC FOR ORDERING INFORMATION. THIS IS A REQUIRED VENDOR, SEE REQUIRED VENDOR LIST ON SHEET A0.1 FOR CONTACT INFORMATION.
- SEE PLAN FOR LENGTH AND QUANTITY OF LINEAR FIXTURES (TYPE LA-48). NOTE: 37W PER 4'-0" LENGTH.
- ELECTRICAL CONTRACTOR TO VERIFY ALL QUANTITIES OF LIGHT FIXTURES PRIOR TO ORDERING FIXTURES.
- FURNISH FIXTURE WITH ALL NECESSARY JOINTS, CONNECTORS, ENDOCAPS, ETC FOR A COMPLETE AND CONTINUOUS FIXTURE LENGTH RUN.
- ALL LIGHT FIXTURES IN THIS SCHEDULE MAY NOT BE APPLICABLE TO THIS PROJECT.**
- LIGHT FIXTURES TO BE SUPPLIED WITH 20' MOUNTING CABLES, POWER FEED CABLE AND MOUNTING BRACKETS WITH SUSPENDED KIT.
- GE STARTER KIT (10 ROW) #93046696-WH FOR CONTINUOUS ROW FIXTURES. PROVIDE ONE (1x) STARTER KIT PER CONTINUOUS ROW.

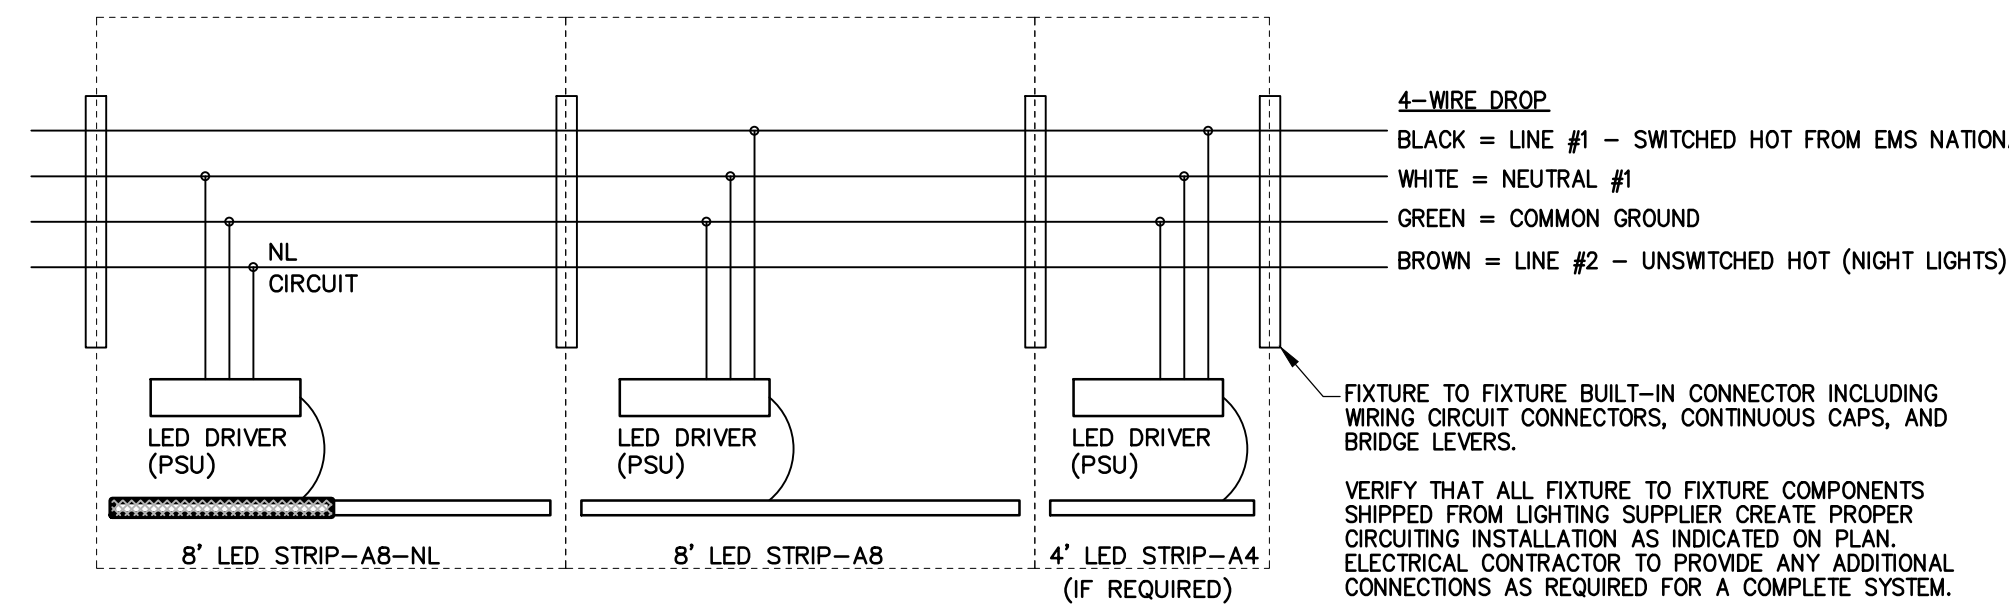

DESIGNER NOTE:
SPECIFY IN LIGHT FIXTURE SCHEDULE OR ON DRAWING IF A LIGHT FIXTURE IS TO BE USED BY ANOTHER ACCOUNT. PROVIDE OTHER INFORMATION AS NECESSARY. PROVIDE APPROPRIATE CONTACT INFORMATION.


DESIGNER NOTE:
DESIGNER TO CENTRE (AS CLOSE AS POSSIBLE) DOWN MAIN AISLE.

5 SALES AREA LIGHT FIXTURE WIRING DETAIL

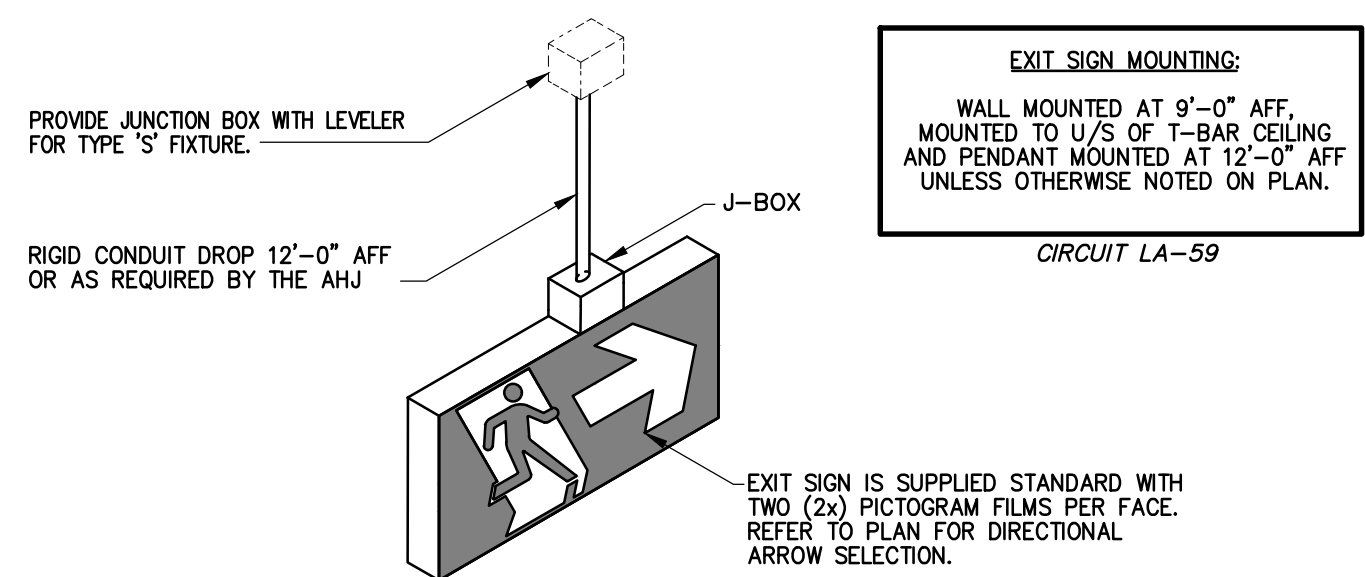


4 PENDANT MOUNT EXIT SIGN

- NOTES:
- CONTRACTOR TO PROVIDE ALL NECESSARY HARDWARE FOR INSTALLATION.
 - LIGHT FIXTURES THAT RUN PARALLEL WITH THE JOISTS SHALL REQUIRE TWO (2x) SEPARATE PIECES OF UNISTRUT, ONE AT EACH END OF LIGHT FIXTURE FOR THE AIRCRAFT CABLE HANGERS.
 - AIR CRAFT CABLE TO BE TRIMMED AFTER FIXTURE INSTALLATION.
 - VERIFY LIGHT FIXTURE AND INSTALLATION WITH PETSMART PROJECT REPRESENTATIVE (COORDINATION VARIES PER PROJECT).
 - CONTRACTOR TO BID GREATER THAN 10 FEET AIR CRAFT CABLE BASED ON SITE SPECIFIC CONDITIONS.
 - PROVIDE AND INSTALL SEISMIC RESTRAINT FOR LIGHT FIXTURES AS REQUIRED BY LOCAL BUILDING CODE.
 - ALL EQUIPMENT, WATER LINES, CEILING GRID, HVAC DUCTWORK, ROOF LEADER PIPING, CONDUITS, LIGHT FIXTURES, AND FIRE SPRINKLER LINES MUST BE SUSPENDED FROM THE JOISTS ONLY. DO NOT LAY ALONG THE BOTTOM CHORD OF JOISTS OR SUSPEND FROM THE ROOF DECK.

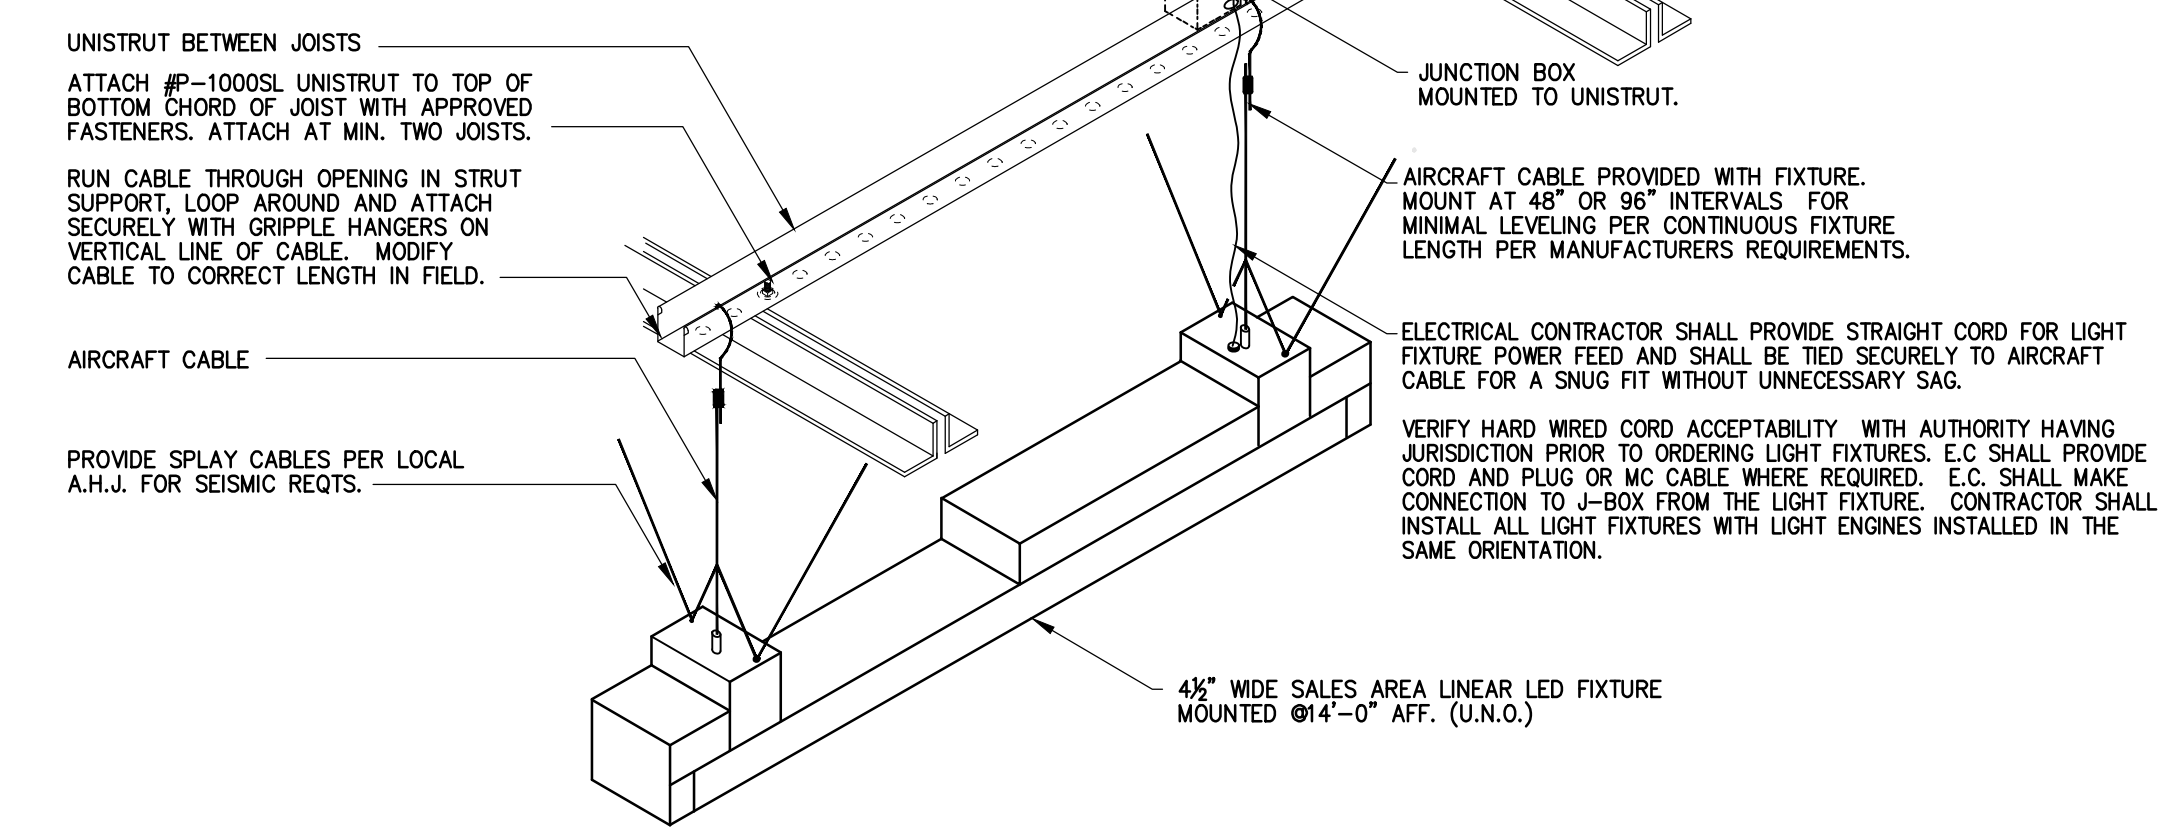

3 LIGHT FIXTURE MOUNTING DETAIL

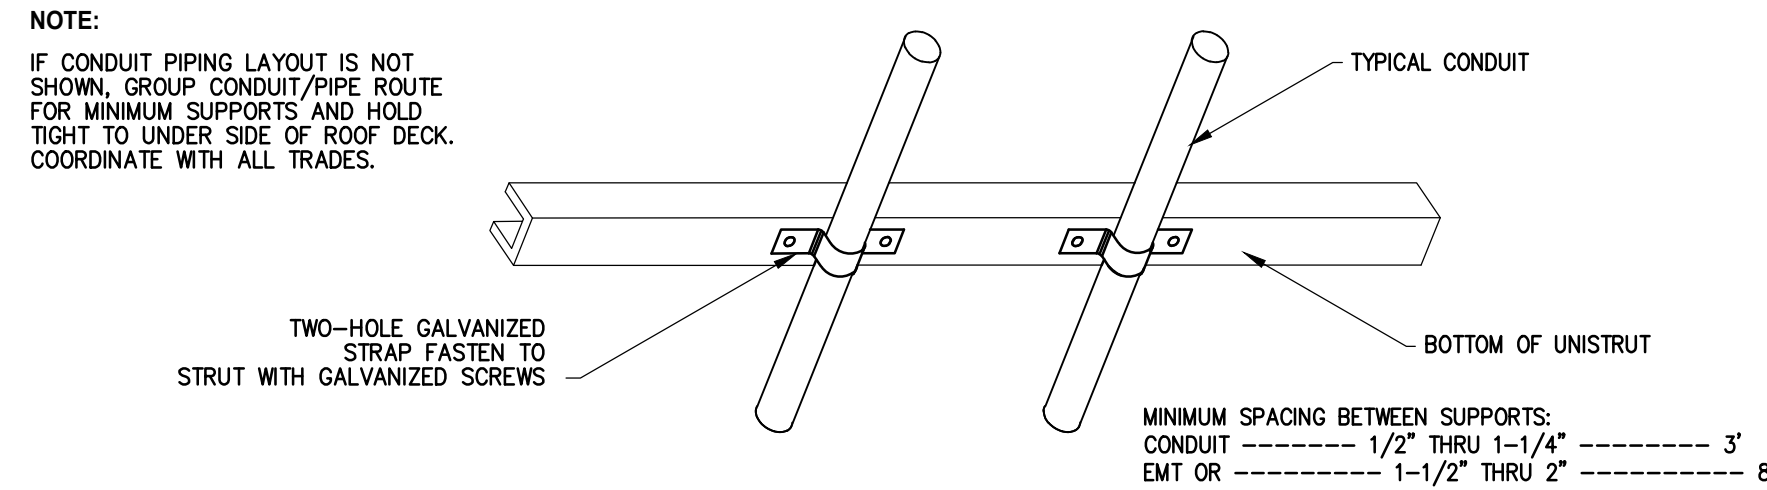

2 CONDUIT/PIPE SUPPORT

